


FIRE HYDRANTS SHALL BE 5'-0" MINIMUM CLEAR FROM TRANSFORMERS.

WARNING: CONTRACTOR SHALL NOT OPEN TRANSFORMER, NOT PUSH CONDUIT UNDER TRANSFORMER, AND NOT INSTALL CONDUCTORS WHEN TRANSFORMER IS ENERGIZED. LIFE THREATENING ELECTRICAL SHOCK MAY OCCUR.

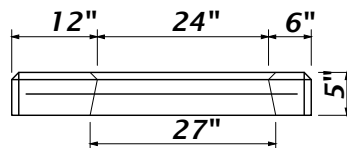

ELEVATION

TRANSFORMER BUSHINGS WILL ACCOMMODATE UP TO 8 SETS OF 500 KCMIL CONDUCTORS.

539

**TYPICAL SINGLE-PHASE
TRANSFORMER PAD
NTS**

