


**NOTES:**

1. COA - APPROVED METER CENTER FURNISHED AND INSTALLED BY CONTRACTOR AND MAINTAINED BY OWNER.
2. METER CENTERS WITH RING TYPE DESIGN SHALL BE FURNISHED BY CONTRACTOR WITH SCREW TYPE RINGS APPROVED BY COA.
3. LINE-SIDE DISCONNECT WITH OVERCURRENT DEVICE IS REQUIRED.
4. LOAD-SIDE SERVICE DISCONNECTS AND OVERCURRENT DEVICES ARE REQUIRED.
5. ALL CONNECTIONS IN THE TRANSFORMER WILL BE MADE BY COA.

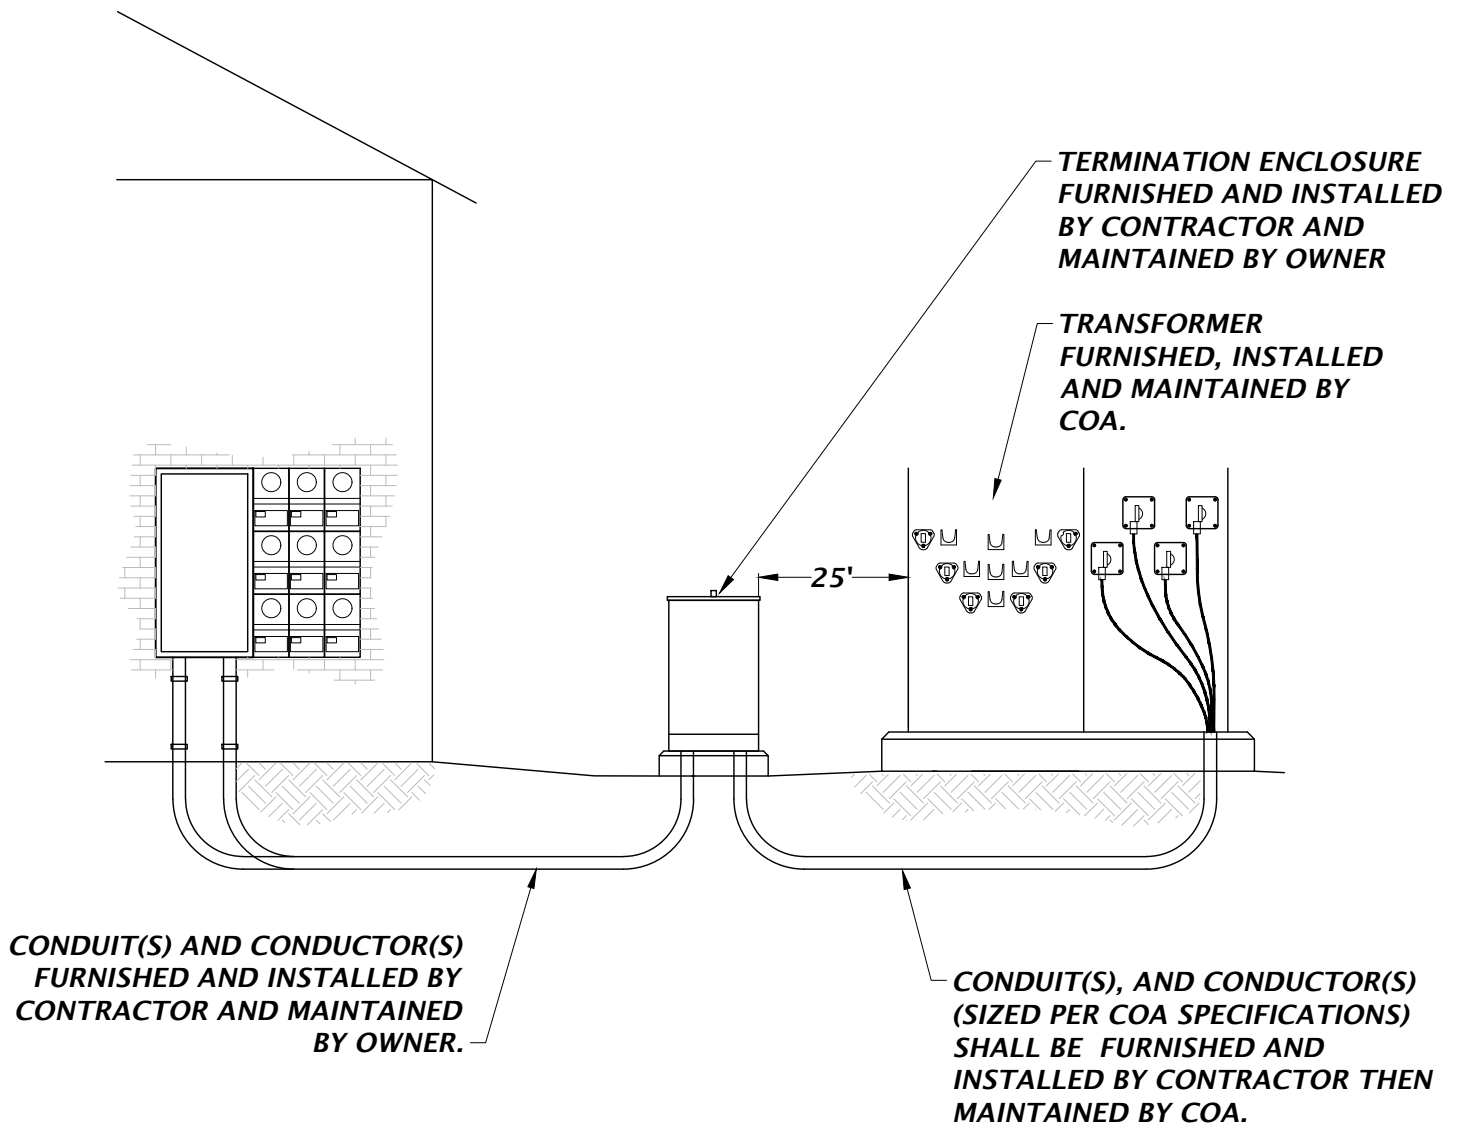

**572**

**ALTERNATIVE NON-RESIDENTIAL UNDERGROUND  
MULTI-METERED SERVICE USING A METER  
CENTER AND A TERMINATION ENCLOSURE**

**NTS**

