


**VIEW LOOKING TOWARD THE TRANSFORMER FRONT
ELEVATION 3-PHASE PAD MOUNT TRANSFORMER**

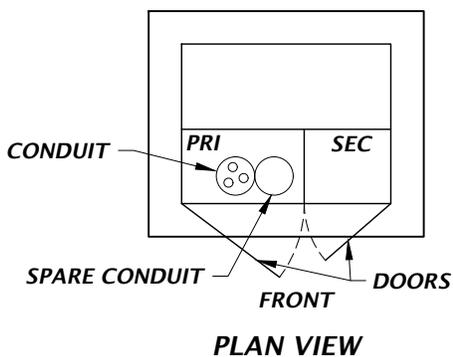

NOTES:

1. STUB UP 3-PHASE PRIMARY CABLE 5'-0" ABOVE GROUND AND IN THE CENTER OF THE PRIMARY TRANSFORMER COMPARTMENT.
2. CAP OR TAPE ALL CUT CABLE ENDS.
3. 3-PHASE PRIMARY REQUIRES 4" PVC CONDUIT.
4. CONDUIT AND CONDUCTORS ARE SHOWN FOR THE RADIAL FEED/LOOP TRANSFORMER CONFIGURATION. FOR LOOP FEED AND OPEN LOOP FEED TRANSFORMERS, PROVIDE CONDUIT AND CONDUCTORS AS REQUIRED.

584C

**THREE-PHASE PAD MOUNT
CONDUIT PLACEMENT
NTS**

